


3/8" EXPANSION MATERIAL THRU JOINTS SHALL BE PLACED AT 90° TO FACE OF CURB AND NO MORE THAN 15 FT. APART. REFER TO APPENDIX 16-D FOR EXPANSION JOINT AND SCORE MARK DETAILS.

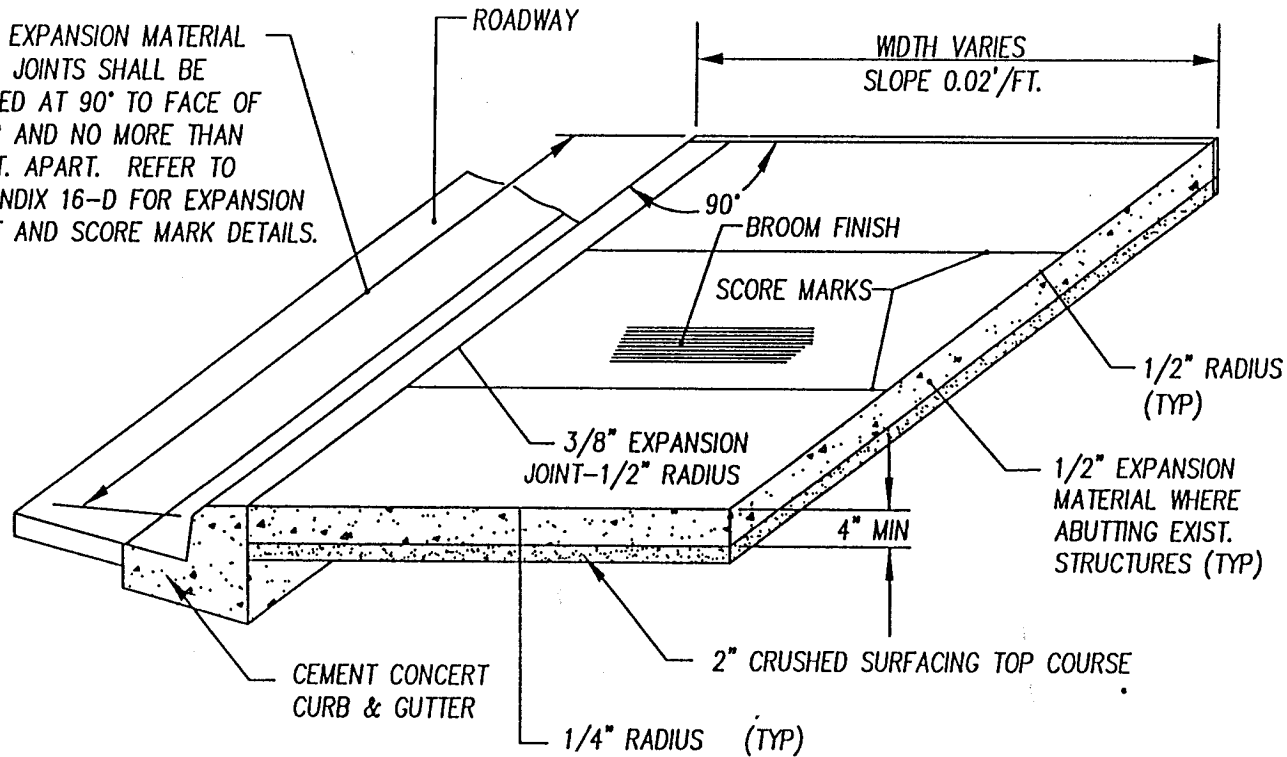

NOTES:

1. FORM AND SUBGRADE INSPECTION REQUIRED BEFORE POURING.
2. CONCRETE SHALL BE AIR ENTRAINED TYPE II PORTLAND CEMENT CLASS 3000.
3. BROOM FINISH SHALL BE PERPENDICULAR TO FACE OF CURB.
4. JOINTS SHALL BE TROWEL FINISHED, AFTER BROOMING.
5. ALL EDGES AND JOINTS SHALL BE FINISHED.
6. WHEN CHECKED WITH A 10 FOOT STRAIGHTEDGE, GRADE SHALL NOT DEVIATE MORE THAN 1/8 INCH, AND ALIGNMENT SHALL NOT VARY MORE THAN 1/4 INCH.

PCCurbGutterWalk.doc



SKAGIT COUNTY  
DEPARTMENT OF  
PUBLIC WORKS

REVISIONS	DATE

ROADWAY  
STANDARDS

**CEMENT CONCRETE CURB,  
GUTTER AND WALK**

**FIGURE C - 7**

6/26/200