



Table 1  
ACM Sample Analytical Results  
700 South 2nd Street, Mt. Vernon, WA  
Skagit County Facilities

Sample ID	Date	Sample Location and Description	Analytical Result (%) <sup>1</sup>	Designation
<i>Samples listed in the order collected. Started at the southern end of Floor #3 in the Health Department offices.</i>				
Floor-1	5/30/2024	Collected from carpet and mastic material located near the middle of the floor inside the Health Department offices (south end of floor).	ND	Not ACM
Floor-2	5/30/2024	Collected from tan 12" x 12" floor tiles located in Work room #357. The asbestos was identified in the black asphaltic mastic (Layer 2 of 2).	5% Chrysotile	ACM
Floor-3	5/30/2024	Collected from tan 12" x 12" floor tiles located in File Storage Room #375. The asbestos was identified in the black asphaltic mastic (Layer 2 of 2).	4% Chrysotile	ACM
Floor-4	5/30/2024	Collected from tan sheet vinyl flooring located in the 'darkroom' #353. The asbestos was identified in the yellow vinyl material (Layer 1 of 3).	2% Chrysotile	ACM
Floor-5	5/30/2024	Collected from beige sheet vinyl material located in Room #352 in front of the radiator. The asbestos was identified in the yellow vinyl material (Layer 1 of 3).	2% Chrysotile	ACM
Floor-6	5/30/2024	Collected from 12" x 12" floor tiles located in the exam room #332 (similar to the other two 12" x 12" tile samples). The asbestos was identified in the black asphaltic mastic (Layer 2 of 2).	6% Chrysotile	ACM
Mastic-1	5/30/2024	Collected from a dark brown brittle mastic material associated with the cove base material located in the reception area.	ND	Not ACM
Floor-7	5/30/2024	Collected from carpet and mastic located in the western hallway near room #329	ND	Not ACM
Floor-8	5/30/2024	Collected from tan 12" x 12" floor tiles located in the Utility Lab Room #317. The asbestos was identified in the black asphaltic mastic (Layer 2 of 2).	5% Chrysotile	ACM
Floor-9	5/30/2024	Collected from gray-blue/brown swirl pattern sheet vinyl flooring located in the eastern hallway outside Room #314's double-doors.	ND	Not ACM
Floor-10	5/30/2024	Collected from carpet and mastic located inside Room #308.	ND	Not ACM

<sup>1</sup> Asbestos containing material is defined as a building material containing 1.0% asbestos or greater by volume  
**BOLD and Shaded** - Indicates that the detected concentration exceeded the definition of an ACM  
 ND - Indicates analyte was Not Detected at level above reporting limit (shown in parentheses)

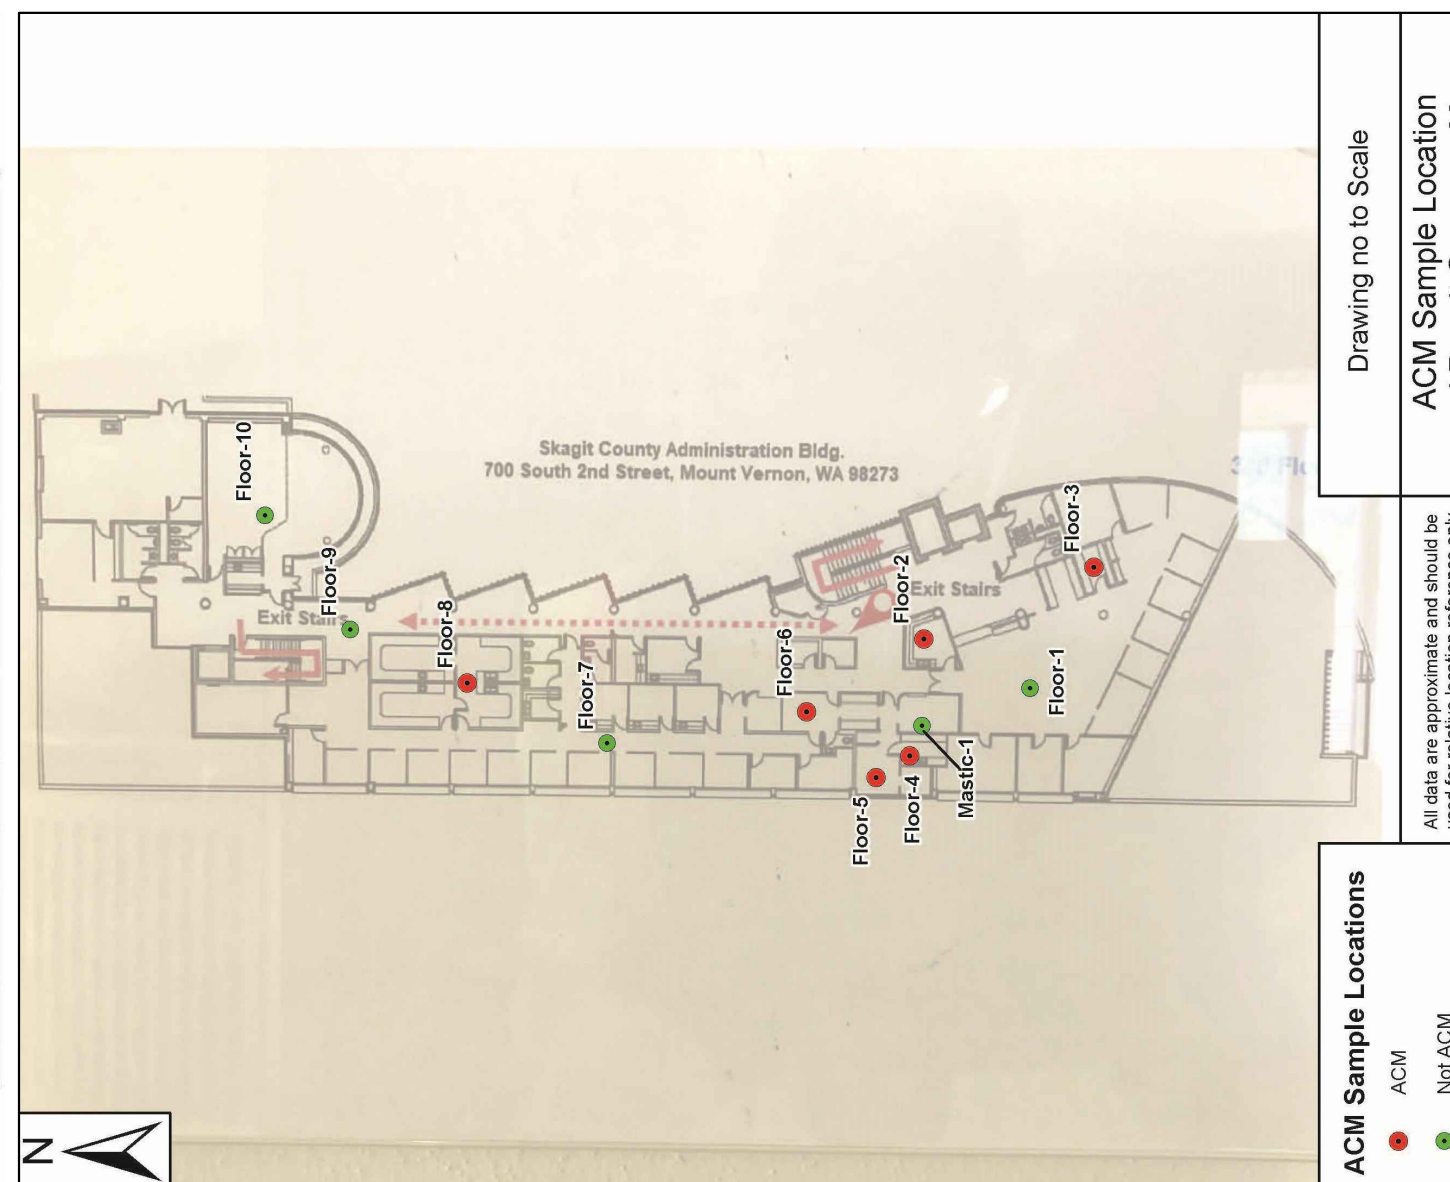


**CONCLUSIONS**  
 ACM was identified in six of eleven samples collected from the third floor of the Skagit County Administration Building.  
 Twelve inch by twelve inch vinyl floor tiles found throughout the floor area were identified with black asphaltic mastic that was identified as ACM. Any black asphaltic mastic discovered during remodel work should be considered ACM unless tested to verify a negative result.  
 The yellow/tan sheet vinyl material found on the third floor was identified as ACM. It is advised that any yellow/tan sheet vinyl observed below carpet or sub-flooring should be considered ACM unless tested to verify a negative result.

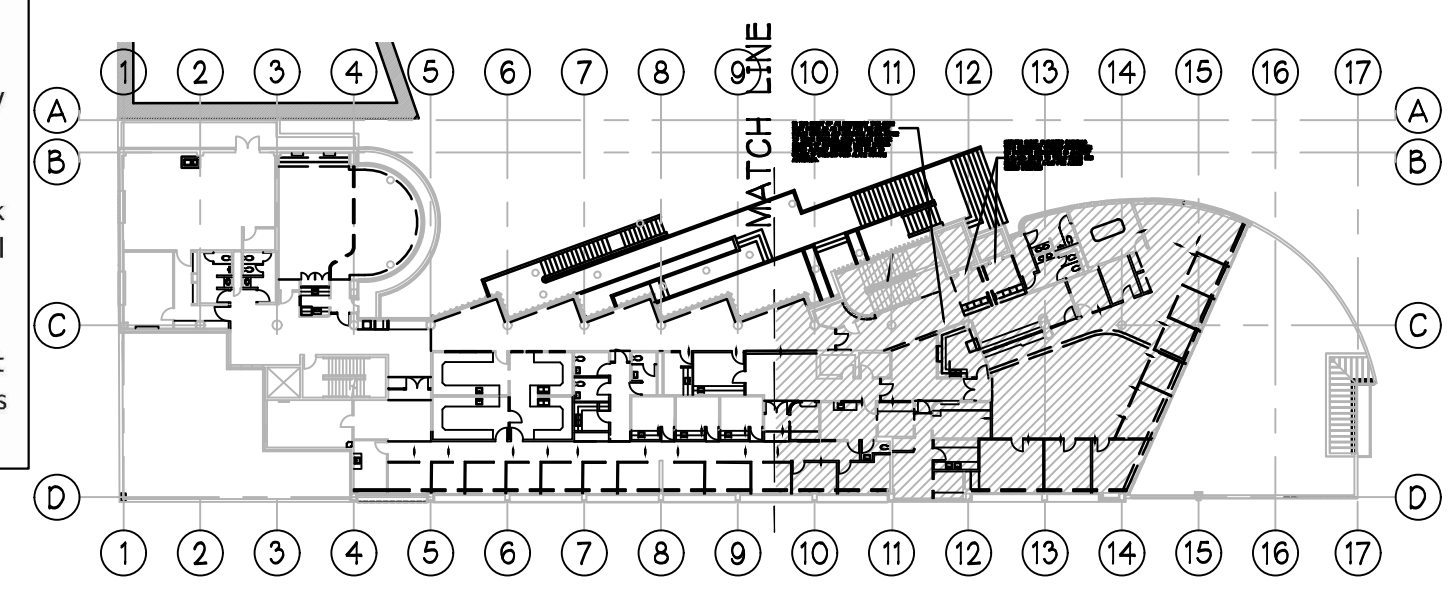

THIRD FLOOR PLAN KEY PLAN  
 1/8"=1'-0"

**CARLETTI ARCHITECTS P.S.**  
 architecture, planning, interior design  
 116 EAST FIR STREET  
 SUITE A  
 MOUNT VERNON, WA. 98273  
 Phone: (360) 424-0394  
 Fax: (360) 424-5726

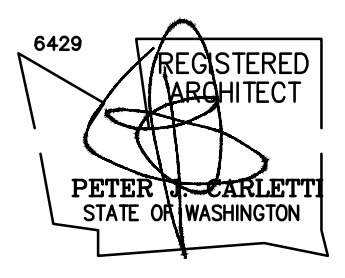

SKAGIT COUNTY  
 ADMINISTRATION BUILDING  
 PROSECUTOR OFFICE T.I.  
 700 S. SECOND STREET  
 MOUNT VERNON, WA 98273

CLIENT CONTACT: KEN HANSEN  
 PHONE: 360-416-1179  
 EMAIL: khansen@co.skagit.wa.us

PROJECT# 23-713.1  
 PROJECT NUMBER:

REVISIONS:

1	03/25/24	PRELIMINARY
	10/25/24	PERMIT BID SET
1	12/3/24	ADDENDUM 1

SHEET TITLE:  
 THIRD FLR. SOUTH DEMO PLAN

PJC  
 PROJECT ARCHITECT.  
 IC  
 DRAWN BY:  
 PJC  
 CHECKED BY:  
 APRIL 22, 2023  
 DATE  
 23-713.1 SC ADMIN. BLDG.  
 COMPUTER FILE NAME

A-2.2  
 COPYRIGHT 2024 CARLETTI ARCHITECTS, P.S.

- LEGEND:**  
 - - - - - WALLS, WINDOWS, DOORS, CASEWORK, PLUMBING ITEMS TO BE REMOVED SEE DEMOLITION KEY NOTES AND LEGEND  
 [Grid Pattern] ASBESTOS FLOORING MATERIAL TO BE REMOVED SEE PROJECT MANUAL FOR OTHER INFORMATION.  
**TYPICAL GENERAL DEMOLITION NOTES.**  
 1. CONTRACTOR SHALL VERIFY ALL DIMENSIONS, MEMBER SIZES AND CONDITIONS OF THE EXISTING BUILDING DEPICTED IN THE DRAWINGS AND NOTIFY ARCHITECT OF ANY DISCREPANCIES FOR POSSIBLE REDESIGN  
 2. SHORING AND BRACING SHALL BE INSTALLED BEFORE ANY STRUCTURAL MEMBERS ARE REMOVED OR BEFORE ANY NEW LOADS ARE ADDED UNTIL PERMANENT SUPPORT AND STIFFENING ARE INSTALLED  
 3. CAP ALL UTILITIES INCLUDING ELECTRICAL, WATER, AND GAS AS REQ'D ONCE DEMOLITION IS COMPLETE

- DEMOLITION FLOOR PLAN NOTES.**
- REMOVE EXIST. PLUMBING FIXTURES, COUNTERTOPS, FLOOR/WALL TILE AND PLASTIC LAMINATE TOILET PARTITIONS. SEE FINISH SCHEDULE SHEET A-2.11 FOR NEW FINISHES. FIELD VERIFY ALL LOCATIONS OF EXIST. FINISHES.
  - REMOVE EXISTING CASEWORK AND COUNTERTOP. PATCH AND REPAIR EXIST. GWB AS REQUIRED. FIELD VERIFY ALL CASEWORK/COUNTERTOPS TO BE REMOVED.
  - REMOVE EXISTING NON-BEARING WALL FRAMING.
  - REMOVE EXIST. WOOD DOOR, HM. FRAME & HARDWARE.
  - REMOVE EXIST. FLOOR FINISHES. REMOVE EXIST. WOOD/VINYL RUBBER BASE AS REQUIRED TO ACCOMMODATE NEW FLOOR FINISHES SEE FINISH SCHEDULE SHEET A-2.11 FOR NEW FINISHES. FIELD VERIFY ALL LOCATIONS OF EXIST. FINISHES.
  - NOT USED
  - REMOVE EXIST. GLASS DISPLAY CASE PATCH AND REPAIR GWB WALL
  - REMOVE/REPLACE EXIST. DRINKING FOUNTAIN
  - REMOVE EXIST. PHONE BOOTH AND CASEWORK PATCH GWB AS REQ'D.
  - REMOVE EXIST. SHELVING PATCH GWB WALL AS REQ'D.
  - REMOVE EXIST. BASEBOARD HEATER AND WATER PIPING PATCH GWB WALL AS REQUIRED
  - REMOVE EXIST. MINI SPLIT UNITS AND WIRING PATCH GWB WALL AS REQUIRED
  - RELOCATE EXISTING ROOF DRAINS AS REQ'D. PATCH AND REPAIR ROOF MEMBRANE AS REQ'D. REROUTE FROM ROOF TO EXIST SECOND FLOOR PENETRATION. SEE MECH. DRAWINGS.
  - REMOVE WALLS, DOORS AND CONT. BUTT GLAZING AT THIS AREA.
  - REMOVE EXISTING CASEWORK, COUNTERTOP, SINK, FAUCET AND ELECTRIC COOKTOP. SEE PROPOSED PLAN AND MECH./ELEC. DWGS. FOR NEW CASEWORK, COUNTERTOPS AND SINK/FAUCET
  - REMOVE EXIST. STOREFRONT AND STOREFRONT DOORS/HARDWARE AND WALL FRAMING BELOW
  - REMOVE ALL EXISTING CASEWORK, COUNTERTOPS, EQUIPMENT, SINKS AND FAUCETS. CAP PLUMBING FOR FUTURE USE.
  - REMOVE EXIST. FIRE EXTINGUISHER.
  - EXIST. FLOOR, CEILING AND WALL FINISHES TO REMAIN
  - EXISTING NEW FLOORING WALL AND CEILING FINISHES TO REMAIN. REPAINT EXISTING WALLS
  - REMOVE EXISTING UPPER CASEWORK TO ACCOMMODATE NEW WINDOW
  - REMOVE AND RELOCATE EXIST. STOREFRONT AND DOOR
  - NOT USED
  - REMOVE EXIST. FIN TUBE RADIATORS
  - REMOVE ASBESTOS CONTAINING MATERIAL
  - REMOVE EXIST. APPROXIMATELY 54" HIGH FRAMED PARTITION WALLS. APPROXIMATELY 240 LINEAL FEET. SEE ELECTRICAL DWGS. FOR DEMO OF ELECTRICAL AND DATA/TELECOM OUTLETS



1 THIRD FLOOR PLAN-SOUTH DEMO PLAN  
 1/8"=1'-0"